



# PGC 4000v2 POWER GENERATION CONTROLLER FOR GCS 2400 SWITCHGEAR

The **PGC 4000v**<sub>2</sub> is an intelligent, integrated full feature Power Generation Controller. The PGC 4000v<sub>2</sub> controller is the power behind the Thomson Power Systems Series 2400 Paralleling Switchgear System.





# THOMSON POWER SYSTEMS PGC 4000v2 OFFERS THE FOLLOWING:

- Superior control & monitoring system for Thomson Power Systems advanced Series 2400 Switchgear (refer to separate literature)
- Flexible Design allows use in Distributed Generation, Automatic Standby or Prime Power Applications
- Integrated design for complete system control and monitoring
- Integrated Revenue Grade Utility and Generator Metering with Power Quality Measurement (exceeds ANSI C12.20 Revenue Class 0.5 accuracy)
- Integral Digital Engine-Generator controls with Automatic Synchronizing & kW/kVAR Load Sharing
- User Friendly 17" color touch screen Operator Interface with run-time configurable Graphics
- High Accuracy Digital Protective Relaying for Generator
   & Utility Supply per IEEE & ANSI standards
- High-Speed / Noise-Immune simultaneous Dual-LAN 1GB/s Ethernet-based Communication provides the most reliable real-time system data transfer available

- Fully Integrated Web / Internet-based Remote Monitoring and Controls provide online service support and system upgrades
- Compliant with IEEE 1547 Distributed Generation Interconnect Standard
- Provides controls for Single or Multiple Generator & Utility Feeder applications
- Certified to UL 508 & CSA 22.2 #14 Industrial Control Equipment Standards
- Capable of Remote Synchronization over Ethernet
- Intelligent Breaker Path determination for engaging Paralleling
- Supports synchronization across dual bus voltage levels
- Unmatched low transient breaker closure transitions using breaker closure detection, dual sync action, multiple synchronizers and predictive algorithms.

#### **STANDARD FEATURES**

The **PGC 4000v**<sup>2</sup> is an intelligent, integrated full feature Power Generation Controller. The PGC 4000v<sup>2</sup> controller is the power behind the Thomson Power Systems Series 2400 Paralleling Switchgear System which provides flexible standard designs that allow automatic paralleling of single or multiple generators for applications including Distributed Generation, Automatic Standby and Prime Power. The new PGC 4000v<sup>2</sup> provides industry leading processing power with Dual 1 Gbps Ethernet Network Communication ports for superior communication reliability and speed.

The PGC 4000v<sub>2</sub> can be configured to operate on low or medium voltage systems and can be applied with a variety of generator set manufacturers and prime movers including diesel or gas reciprocating engines and gas or steam driven turbines. The PGC 4000v<sub>2</sub> integrates a vast array of advanced control and monitoring features with Thomson Power Systems unique run-time configurability feature. Some of the advanced integrated features include utility/generator revenue grade power metering, protective relaying, engine control, automatic synchronizing and automatic kW / kVAR load sharing.

The PGC 4000v<sub>2</sub> utilizes full color, touch screen, graphical operator interface display and combined with Thomson's Internet/web ready Ethernet communications make it the most user friendly, integrated power generation system controller on the market. By incorporating advanced communication interfaces, the PGC 4000v<sub>2</sub> can operate in harmony with any PLC or building management system, providing maximum equipment utilization and total energy management.

The PGC 4000v<sub>2</sub> is comprised of a door mounted operator interface display and the PGC 4000v<sub>2</sub> controller, which is mounted in the switchgear control compartment. The operator interface display and control modules are interconnected with a high speed 1GB/s Ethernet communication cable with a simultaneous Dual LAN option. One controller module is required for each generator set. One operator interface display is provided for the complete system. Additional operator interface screens can be supplied as required.



## **APPLICATIONS**

The **PGC 4000v**<sup>2</sup> can be applied to numerous types of power generation systems. Its flexible configuration allows application in new installations as well as existing systems when generators require upgrading for parallel or peaking operation with the utility supply. Typical system applications include the following:

- **Distributed Generation (DG):** Distributed Generation systems provide the capability of synchronizing single or multiple generators to the utility grid to allow soft-load transfer, parallel generation, peak shaving, or Cogeneration operation.
- Auto Standby (AS): Automatic Standby systems control single or multiple generator sets to provide automatic standby power during a utility power failure. Auto standby systems can be designed with an integral transfer system between the utility supply and emergency bus. Auto standby systems can also work with external distributed transfer schemes. With the use of the PGC 4000v<sub>2</sub>, load demand starting is incorporated to maintain optimal efficiency and reliability of your generator sets during a power failure. Load management schemes can be provided to prevent your system from being overloaded, resulting in costly and dangerous downtime.
- Prime Power (PP): Prime Power systems provide power and control for applications where local utility supply is unreliable, unavailable, or uneconomical to install. With the PGC 4000v<sub>2</sub>, these systems can incorporate automatic synchronizing, soft-load transfer, fuel economizing, or run-time hour balancing.

#### PGC 4000v2 STANDARD MONITORING AND CONTROL FEATURES

**Operator Interface:** The **PGC 4000v2** color, touch screen, operator interface can display all information related to single or multiple unit applications. Information is displayed using multiple analog and digital methods. The display can be configured for user specified screen layouts utilizing the PGC's run-time programming capability. Access to all screens is provided via multi-level user access security system. The display(s) are factory programmed to provide the following system information:

- Generator Power Metering: Digital and Analog 3 phase
   RMS power metering (Voltage, Current, Frequency, kW, kVA, KVAR, Power Factor)
- Generator Power Quality: Phase Harmonics, Phasor Diagrams (Voltage & Current) Total harmonic distortion (Voltage & Current), Waveform capture
- Generator Protective Relaying: IEEE protective functions 25, 32, 27, 40, 51, 59, 81o/u
- Engine Control: Alarm / shutdown annunciation, engine gauge data (speed, oil pressure, temperature, fuel level etc.), start/stop control, and operating mode of the engine
- Engine/Generator Shutdown & Alarm Annunciation: Screens showing active alarms and shutdowns
- Engine / Generator Event Logging: a historical list of system alarms or shutdowns with time, date and event listing
- Utility Power Metering: Digital and Analog 3 phase RMS utility power metering (Voltage, Current, Frequency, kW, kVA, KVAR, Power Factor)

- Utility Power Quality: Phase Harmonics, Phasor Diagrams (Voltage & Current) Total harmonic distortion (Voltage & Current), Waveform capture
- Utility Protective Relaying: IEEE protective functions 25, 32, 27, 59, 81o/u
- **Single Line Diagram:** Graphical display of the generator electrical system showing breaker position, bus status, operating generator modes and summary alarm screen
- **Configuration Settings:** Password protected access to set time delays, load setpoints, programmable logic





#### PGC 4000v2 STANDARD MONITORING AND CONTROL FEATURES

**Power Metering / Power Quality:** The **PGC 4000v**<sub>2</sub> provides digital and analog display of power metering and power quality data for both the generator and utility sources via the operator interface display. In addition, load voltage and frequency metering data are monitored and displayed which is utilized for synchronizing and dead bus closing logic. The Power Metering data complies with revenue accuracy standards as per ANSI C12.20 Class 0.5 accuracy. The following power metering and power quality data is provided:

- **Generator Supply:** 3 phase voltage, current, frequency, kW, kVAR, kVA, power factor, kW hours, kVAR hours, Phase Harmonics, Phasor Diagrams (Voltage & Current), Total harmonic distortion (Voltage & Current), Waveform capture
- Utility Supply: 3 phase voltage, current, frequency, kW, kVAR, kVA, power factor, kW hours, kVAR hours,

Phase Harmonics, Phasor Diagrams (Voltage & Current), Total harmonic distortion (Voltage & Current), Waveform capture.

**Load Bus:** 3 phase voltage and frequency, Phase Harmonics and Phasor Diagrams (Voltage), Waveform capture

**Protective Relaying:** The **PGC 4000v2** provides configurable protective relaying functions for both Generator and Utility supplies via the operator interface graphical screen. Single cycle calculations are used to drive output relays allowing fast protection operation when required. The following protective functions are provided as standard per PGC 4000v<sub>2</sub> controller:

- Generator
  25 Sync-Check
  32R Reverse Power
  27 Under voltage
  40 Reverse VARs
  51 Time Over current
  59 Over voltage
  81o/u Under / Over Frequency (2 stage)
- Utility
  - 25 Sync-Check
    32R Reverse Power
    27 Under voltage
    51 Time Over current
    59 Over voltage
    81o/u Under / Over Frequency (2 stage)

**Automatic Load Sharing:** The **PGC 4000v2** provides Automatic kW & kVAR load sharing control when generators are paralleled to each other or a utility supply. Automatic load sharing utilizes the PGC's high precision digital power data which is shared over Ethernet communication links to ensure fast and reliable operation. The PGC 4000v<sub>2</sub> is able to interface with engine electronic governors and alternator excitation systems for paralleling power control. The following kW and kVAR control functionality is provided as standard:

- Gen to Gen isochronous load sharing: percentage based, constant voltage and speed kW and kVAR load sharing.
- **kW Load ramping:** Adjustable ramp rates for loading and unloading of the generator and utility supplies
- **kW Base Loading:** Adjustable generator and utility base loading setpoints for parallel operation of the generator system with the utility grid.
- **kVAR (Power Factor) Control:** Adjustable setpoints for constant generator levels or utility levels
- Min / Max Load Limits: Programmable setpoints to provide desired min/max levels of equipment operation
- **Import kW Control:** Programmable to allow import power operation when paralleling with the utility supply

**Automatic Synchronizing:** The **PGC 4000v**<sub>2</sub> provides fully automatic or manual synchronization control. Automatic synchronization utilizes the PGC's high precision digital frequency, voltage and phase angle data to ensure fast and reliable operation. Manual synchronization allows user adjustable voltage and frequency via the PGC 4000v<sub>2</sub> controller and userinitiated breaker closure with integral out-of-phase sync check protection. Synchronization is possible between any 3 voltage measurement sources. Synchronizing controls are designed to interface with most common engine electronic governors and alternator excitation systems. The following synchronizing functionality is provided as standard:

- Speed Matching: Adjustable gain & stability setpoints
   to allow fast and accurate speed/frequency control for automatic synchronizing using both Dual Action phase lock or Enhanced Dual Action Slip Sync.
- **Synchroscope:** Graphical waveform display between generator and utility supply
- **Voltage Matching:** Adjustable gain & stability setpoints to allow fast and accurate voltage control for automatic synchronizing
- Auto / Test/Manual Sync Modes: Programmable to operation mode desired
- Fail to Sync Alarming: Automatic logic continually monitorsthe automatic synchronizing process and activates alarms should abnormal conditions occur
- Voltage Monitoring: 3 phase voltage is monitored prior to synchronization to ensure correct phase rotation and correct voltage levels
- **Dual Dynamic Synchronizers:** Two independent sets of synchronizing algorithms have been developed to enable optimum system tuning to deliver highly reliable automatic synchronizing for changing generator load conditions.



# PGC 4000v<sub>2</sub> STANDARD MONITORING AND CONTROL FEATURES

**Engine Control:** The **PGC 4000v2** is configured with integral engine controls. The PGC 4000v2 may also be configured to operate with external unit mounted engine / generator control. The following engine / generator controller features are provided as standard:

- **Auto Start Control:** Cycle cranking with integral speed sensor for crank disconnect and overspeed
- **39 Digital / Analog Fault Alarms / Shutdown Inputs:** Alarms/shutdowns to meet/exceed requirements of NFPA 99, 110 & CSA 282
- Engine Parameter Display: Digital and analog display of oil pressure, oil temperature, coolant temp, battery voltage, RPM, and fuel level
- **22 Output Contacts:** Alarm and shutdown/control contacts for remote indication
- 8 Configurable and Scalable Analog Outputs for indication or control
- Configurable Setpoints / Time Delays: Password protected access to set time delays (engine start, crank, rest, cooldown, oil bypass etc.)

**Remote Communication:** The PGC 4000v<sub>2</sub> has high speed communication ports allowing flexible integration to many types of local and remote monitoring systems. The PGC 4000v<sub>2</sub> display provides an isolated outside world Ethernet port for Internet/ network access. Standard Internet browser software with Windows<sup>TM</sup> 7 Pro is required to remotely monitor the system.

The PGC 4000v<sub>2</sub> contains the following communication ports and protocols:

- Controller Port Ethernet/UDP: High-speed 1GB/s communications to Display(s), and PGC 4000v2 Device Network using proprietary simultaneous Dual LAN protocol
- **Display Port-Ethernet/UDP:** High-speed 1GB/s communication to other Display(s), and PGC 4000v2 Device network
- **Display Port Ethernet:** High-speed communications port for Customer use allowing remote monitoring/ control stations using the Internet or local area network

The PGC 4000v2 with Series 2400 Paralleling Switchgear can be provided with the following communication ports for customer connection with local and remote communication interface systems:

- MODBUS<sup>RTU</sup> Serial
- MODBUS TCP (Ethernet)
- Remote Access (Lan/Internet) Web Server
- Email/Pager on alarm

**Programmable Logic Inputs / Outputs**: The **PGC 4000v2** has user-friendly programmable logic which also provides sophisticated control features. Programming is run-time configurable and allows users to tie any setpoint, fault or digital value to any output relay. Execution time of the programmable logic is less than two power cycles, activating outputs in milliseconds for critical control operations.

The PGC 4000v<sub>2</sub> provides the following functions:


- Digital Inputs: Can be programmed to activate internal logic or alarm functions
- **Digital Outputs:** Outputs can be programmed using graphical Boolean logic (e.g. AND/OR/NAND/NOR gates) and/or with setpoint pickup/dropout timers
- Analog Signals: Analog signals can be programmed to alarm at desired levels with time delays as required



Power Supply Input Voltage         18 - 36Vdc           Temperature Range (Controller)         -15°C to 50°C           Environment Rating (Controller)         NEMA 1           HARDWARE INPUTS         Source 1.2 Voltage and Current Sensing (Generator & Utility)           8 - PT Voltage Inputs         600V RMS line-to-line (nominal)           8 - CT Inputs         600V RMS line-to-line (nominal)           8 - CT Inputs         5A Nominal, 10A Over range           Operating System Frequency         600V RMS line - to - line (nominal)           8 - CT Inputs         600V RMS line - to - line (nominal)           8 - CT Inputs         600V RMS line - to - line (nominal)           Analog Inputs         600V RMS line - to - line (nominal)           Analog Inputs         0 - 40Vdc           8 Analog Inputs         0 - 20ma, 0 - 5Vdc           Solated Digital Inputs         0 - 20ma, 0 - 5Vdc           8 Analog Inputs         0 - 20ma, 0 - 5Vdc           8 Malog Inputs         100 - 20,000Hz, 1.0 - 20VAC RMS           8 Mander Pickup Sensing         100 - 20,000Hz, 1.0 - 20VAC RMS           8 Mander DUTPUTS         250VAC 5A, 30Vdc 5A           Run - Form A         250VAC 5A, 30Vdc 5A           2 Digital Outputs - Form A         250VAC 5A, 30Vdc 5A           2 Digital Outputs - Form A         250VAC 5A,	GENERAL	
Environment Rating (Controller)         NEMA 1           HARDWARE INPUTS         Source 1, 2 Voltage and Current Sensing (Generator & Utility)         600V RMS line-to-line (nominal)           8 - PT Voltage Inputs         600V RMS line-to-line (nominal)         6           8 - CT Inputs         5A Nominal, 10A Over range         Operating System Frequency         50/60Hz           Source 3 Voltage Sensing (Load)         600V RMS line - to - line (nominal)         Analog Inputs         600V RMS line - to - line (nominal)           Analog Inputs         600V RMS line - to - line (nominal)         Analog Inputs         0 - 40Vdc           8 Analog Inputs         0 - 40Vdc         8 Analog Inputs         0 - 20ma, 0 - 5Vdc           Isolated Digital Inputs         0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs         Normally closed contact sense           RPM         Magnetic Pickup Sensing         100 - 20,000Hz, 10 - 20VAC RMS         RABDWARE OUTPUTS           Output Contacts         250VAC 5A, 30Vdc 5A         22 Digital Outputs - Form A         250VAC 5A, 30Vdc 5A           8 Analog Inputs         0 - 20ma, 0 - 5Vdc         250VAC 5A, 30Vdc 5A         22 Digital Outputs - Form A           22 Digital Outputs - Form A         250VAC 5A, 30Vdc 5A         22 Digital Outputs - Form A         250VAC 5A, 30Vdc 5A           8 Analog Inputs         0 - 20ma, 0 - 5Vdc         0 - 200m	Power Supply Input Voltage	18 - 36Vdc
HARDWARE INPUTS Source 1, 2 Voltage and Current Sensing (Generator & Utility) 8 - PT Voltage Inputs 6 A Nominal, 10A Over range Operating System Frequency 50/60Hz Source 3 Voltage Sensing (Load) 4 - PT Voltage Inputs 6 000V RMS line - to - line (nominal) Analog Inputs 4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level) 3 - 240 Ohm/Datcon External Battery Voltage Inputs 6 - 40Vdc 8 Analog Inputs 7 - 40Vdc 8 Analog Inputs 7 - 2000Hz, 10 - 2000Hz, 10 - 2000Hz, 10 - 2000Hz, 10 - 2004C RMS 7 - 2000Hz, 10 - 2004C RMS 7 - 2004C RM	Temperature Range (Controller)	-15°C to 50°C
Source 1, 2Voltage and Current Sensing (Generator & Utility)         600V RMS line-to-line (nominal)           8 - PT Voltage Inputs         50 Nominal, 10A Over range           Operating System Frequency         50/60Hz           Source 3 Voltage Sensing (Load)         600V RMS line - to - line (nominal)           4 - PT Voltage Inputs         600V RMS line - to - line (nominal)           Analog Inputs         600V RMS line - to - line (nominal)           4 - PT Voltage Inputs         600V RMS line - to - line (nominal)           4 Analog Inputs         600V RMS line - to - line (nominal)           4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level)         33 - 240 Ohm/Datcon           8 Analog Inputs         0 - 40Vdc         0 - 40Vdc           8 Analog Inputs         0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs           Berregency Stop         Normally closed contact sense         RPM           Magnetic Pickup Sensing         100 - 20,000Hz, 10 - 20VAC RMS         RARDWARE OUTPUTS           Output Contacts         250VAC 5A, 30Vdc 5A         Regence           Run - Form A         250VAC 5A, 30Vdc 5A         Regence           Run - Form A         250VAC 5A, 30Vdc 5A         Regence           Run - Form A         250VAC 5A, 30Vdc 5A         Regence           Sonalog Inputs         0 - 20ma, 0 - 5V	Environment Rating (Controller)	NEMA 1
8 - PT Voltage Inputs       600V RMS line-tc-line (nominal)         8 - CT Inputs       5A Nominal, 10A Over range         Operating System Frequency       50/60Hz         Source 3 Voltage Sensing (Load)       600V RMS line - to - line (nominal)         4 - PT Voltage Inputs       600V RMS line - to - line (nominal)         Analog Inputs       0         4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level)       33 - 240 Ohm/Datcon         External Battery Voltage Input       0 - 40Vdc         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       Normally closed contact sense         RPM       Normally closed contact sense         Magnetic Pickup Sensing       100 - 20,000Hz, 1.0 - 20VAC RMS         HARDWARE OUTPUTS       Output Contacts         Crank - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         Quiputs       0 - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1       +/ SVdc         Voltage Regulator Control Interface #2       4/ 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #2	HARDWARE INPUTS	
8 - CT Inputs       5A Nominal, 10A Over range         Operating System Frequency       50/60Hz         Source 3 Voltage Sensing (Load)       600V RMS line - to - line (nominal)         A - PT Voltage Inputs       600V RMS line - to - line (nominal)         Analog Inputs       0 - 40Vdc         4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level)       33 - 240 Ohm/Datcon         External Battery Voltage Input       0 - 40Vdc         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       0 - 20ma, 0 - 5Vdc         Bergency Stop       Normally closed contact sense         31 Digital Inputs       Normally open contact sense         RPM       Understand Context Sense         MARDWARE OUTPUTS       Output Contacts         Output Contacts       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         22 Digital Outputs - Form A       250VAC 5A, 30Vdc 5A         23 Digital Outputs - Form A       250VAC 5A, 30Vdc 5A         24 Digital Regulator Control Interface #1       +/- 9Vdc         Voltage Regulator Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation	Source 1, 2 Voltage and Current Sensing (Generator & Utility)	
Operating System Frequency       50/60Hz         Source 3 Voltage Sensing (Load)       600V RMS line - to - line (nominal)         Analog Inputs       600V RMS line - to - line (nominal)         Analog Inputs       0 - 40Vdc         8 Analog Inputs       0 - 40Vdc         8 Analog Inputs       0 - 40Vdc         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       Normally closed contact sense         Bremgency Stop       Normally open contact sense         31 Digital Inputs       Normally open contact sense         RPM       100 - 20,000Hz, 1.0 - 20VAC RMS         HARDWARE OUTPUTS       250VAC 5A, 30Vdc 5A         Output Contacts       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         Soligal Outputs       O - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1       +/- 9Vdc         Voltage Regulator Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation         COMMUNICATION       0 - 500Hz pulse width modulation	8 - PT Voltage Inputs	600V RMS line-to-line (nominal)
Source 3 Voltage Sensing (Load)         4 - PT Voltage Inputs         4 - PT Voltage Inputs         4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level)       33 - 240 Ohm/Datcon         External Battery Voltage Input       0 - 40Vdc         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       Normally closed contact sense         Brengency Stop       Normally open contact sense         31 Digital Inputs       Normally open contact sense         RPM       100 - 20,000Hz, 1.0 - 20VAC RMS         HARDWARE OUTPUTS       250VAC 5A, 30Vdc 5A         Output Contacts       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         22 Digital Outputs - Form A       250VAC 5A, 30Vdc 5A         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1       +/- 3Vdc         Voltage Regulator Control Interface #2       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation	8 - CT Inputs	5A Nominal, 10A Over range
4 - PT Voltage Inputs       600V RMS line - to - line (nominal)         Analog Inputs         4 Engine Sender Inputs (Coolant Temp, Oil Press, Fuel Level)       33 - 240 Ohm/Datcon         External Battery Voltage Input       0 - 40Vdc         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       Normally closed contact sense         8 PM       Normally closed contact sense         RPM       100 - 20,000Hz, 1.0 - 20VAC RMS         HARDWARE OUTPUTS       Output Contacts         Crank - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         Solated Digital Inputs       0 - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1       4/- 9Vdc         Voltage Regulator Control Interface #2       4/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 50Hz pulse width modulation	Operating System Frequency	50/60Hz
Analog Inputs         4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level)       33 - 240 Ohm/Datcon         External Battery Voltage Input       0 - 40Vdc         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs       Normally closed contact sense         31 Digital Inputs       Normally closed contact sense         RPM       Normally open contact sense         Magnetic Pickup Sensing       100 - 20,000Hz, 10 - 20VAC RMS         HARDWARE OUTPUTS       Output Contacts         Crank - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         22 Digital Outputs - Form A       250VAC 5A, 30Vdc 5A         Analog Outputs       0 - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1       +/- 9Vdc         Voltage Regulator Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation	Source 3 Voltage Sensing (Load)	
4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level)       33 - 240 Ohm/Datcon         External Battery Voltage Input       0 - 40Vdc         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs         Emergency Stop       Normally closed contact sense         31 Digital Inputs       Normally open contact sense         RPM         Magnetic Pickup Sensing       100 - 20,000Hz, 10 - 20VAC RMS         HARDWARE OUTPUTS         Output Contacts         Crank - Form A         250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         22 Digital Outputs - Form A       250VAC 5A, 30Vdc 5A         Alalog Inputs         Voltage Regulator Control Interface #1       +/- 9Vdc         Voltage Regulator Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation	4 - PT Voltage Inputs	600V RMS line - to - line (nominal)
External Battery Voltage Input0 - 40Vdc8 Analog Inputs0 - 20ma, 0 - 5VdcIsolated Digital InputsEmergency StopNormally closed contact sense31 Digital InputsNormally open contact senseRPMMagnetic Pickup Sensing100 - 20,000Hz, 1.0 - 20VAC RMSHARDWARE OUTPUTSOutput ContactsCrank - Form A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A20 Jugital Outputs - Form A0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #1+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #30 - 500Hz pulse width modulationCOMMUNICATION	Analog Inputs	
8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Isolated Digital Inputs         Emergency Stop       Normally closed contact sense         31 Digital Inputs       Normally open contact sense         RPM         Magnetic Pickup Sensing         MARDWARE OUTPUTS         Output Contacts         Crank - Form A         250VAC 5A, 30Vdc 5A         RPM         Output Contacts         Crank - Form A         250VAC 5A, 30Vdc 5A         RPM         Output Contacts         Crank - Form A         250VAC 5A, 30Vdc 5A         Rem 2         Output Contacts         Crank - Form A         StoVAC 5A, 30Vdc 5A         Rem 2         Output S         Output Contacts         Colspan= 0 - 5Vdc         Analog Outputs         O - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1         V/ SVdc         Voltage Regulator Control Interface #1 <t< td=""><td>4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level)</td><td>33 - 240 Ohm/Datcon</td></t<>	4 Engine Sender Inputs (Coolant Temp, Oil Temp, Oil Press, Fuel Level)	33 - 240 Ohm/Datcon
Isolated Digital InputsEmergency StopNormally closed contact sense31 Digital InputsNormally open contact senseRPMI00 - 20,000Hz, 1.0 - 20VAC RMSHARDWARE OUTPUTSI00 - 20,000Hz, 1.0 - 20VAC RMSOutput ContactsCrank - Form A250VAC 5A, 30Vdc 5A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5A8 Analog Inputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #1+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #1- 10VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #30 - 500Hz pulse width modulationCOMMUNICATIONControl Interface #30 - 500Hz pulse width modulation	External Battery Voltage Input	0 - 40Vdc
Emergency StopNormally closed contact sense31 Digital InputsNormally open contact senseRPMMagnetic Pickup Sensing100 - 20,000Hz, 1.0 - 20VAC RMSHARDWARE OUTPUTSOutput ContactsCrank - Form A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5A20 jigital Outputs - Form A20 jigital Outputs - Form A20 - 20ma, 0 - 5VdcAnalog Inputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 3VdcVoltage Regulator Control Interface #1+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #30 - 500Hz pulse width modulationCOMMUNICATION	8 Analog Inputs	0 - 20ma, 0 - 5Vdc
31 Digital Inputs       Normally open contact sense <b>RPM</b> Magnetic Pickup Sensing       100 - 20,000Hz, 1.0 - 20VAC RMS <b>HARDWARE OUTPUTS Output Contacts</b> Crank - Form A       250VAC 5A, 30Vdc 5A         Run - Form A       250VAC 5A, 30Vdc 5A         22 Digital Outputs - Form A       250VAC 5A, 30Vdc 5A <b>Analog Outputs</b> 250VAC 5A, 30Vdc 5A <b>8</b> Analog Inputs       0 - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1       +/- 9Vdc         Voltage Regulator Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation <b>COMMUNICATION</b>	Isolated Digital Inputs	
<b>PPM</b> Magnetic Pickup Sensing100 - 20,000Hz, 1.0 - 20VAC RMS <b>HARDWARE OUTPUTSOutput Contacts</b> Crank - Form A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5A8 Analog Outputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #2+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #30 - 500Hz pulse width modulationCOMMUNICATION	Emergency Stop	Normally closed contact sense
Magnetic Pickup Sensing100 - 20,000Hz, 1.0 - 20VAC RMSHARDWARE OUTPUTSOutput ContactsCrank - Form A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5A8 Analog Outputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #2+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #30 - 500Hz pulse width modulationCOMMUNICATION-	31 Digital Inputs	Normally open contact sense
HARDWARE OUTPUTSOutput ContactsCrank - Form A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5AAnalog Outputs8 Analog Inputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #2+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #30 - 10VdcCOMMUNICATION-	RPM	
Output ContactsCrank - Form A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A0-20ma, 0-5VdcAnalog Outputs0 - 20ma, 0 - 5Vdc8 Analog Inputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #2+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #30 - 10VdcCOVIMUNICATION-	Magnetic Pickup Sensing	100 - 20,000Hz, 1.0 - 20VAC RMS
Crank - Form A250VAC 5A, 30Vdc 5ARun - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5AAnalog Outputs8 Analog Inputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #2+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #30 - 500Hz pulse width modulationCOMMUNICATION	HARDWARE OUTPUTS	
Run - Form A250VAC 5A, 30Vdc 5A22 Digital Outputs - Form A250VAC 5A, 30Vdc 5AAnalog Outputs08 Analog Inputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #2+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #20 - 500Hz pulse width modulationCOMMUNICATION-	Output Contacts	
22 Digital Outputs - Form A250VAC 5A, 30Vdc 5AAnalog Outputs0 - 20ma, 0 - 5Vdc8 Analog Inputs0 - 20ma, 0 - 5VdcVoltage Regulator Control Interface #1+/- 9VdcVoltage Regulator Control Interface #2+/- 3VdcEngine Governor Control Interface #1+/- 3VdcEngine Governor Control Interface #20 - 10VdcEngine Governor Control Interface #30 - 500Hz pulse width modulationCOMMUNICATION	Crank - Form A	250VAC 5A, 30Vdc 5A
Analog Outputs         8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1       +/- 9Vdc         Voltage Regulator Control Interface #2       +/- 3Vdc         Engine Governor Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation	Run - Form A	250VAC 5A, 30Vdc 5A
8 Analog Inputs       0 - 20ma, 0 - 5Vdc         Voltage Regulator Control Interface #1       +/- 9Vdc         Voltage Regulator Control Interface #2       +/- 3Vdc         Engine Governor Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation         COMMUNICATION	22 Digital Outputs - Form A	250VAC 5A, 30Vdc 5A
Voltage Regulator Control Interface #1       +/- 9Vdc         Voltage Regulator Control Interface #2       +/- 3Vdc         Engine Governor Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation         COMMUNICATION	Analog Outputs	
Voltage Regulator Control Interface #2       +/- 3Vdc         Engine Governor Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation         COMMUNICATION	8 Analog Inputs	0 - 20ma, 0 - 5Vdc
Engine Governor Control Interface #1       +/- 3Vdc         Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation         COMMUNICATION	Voltage Regulator Control Interface #1	+/- 9Vdc
Engine Governor Control Interface #2       0 - 10Vdc         Engine Governor Control Interface #3       0 - 500Hz pulse width modulation         COMMUNICATION	Voltage Regulator Control Interface #2	+/- 3Vdc
Engine Governor Control Interface #3       0 - 500Hz pulse width modulation         COMMUNICATION	Engine Governor Control Interface #1	+/- 3Vdc
COMMUNICATION	Engine Governor Control Interface #2	0 - 10Vdc
	Engine Governor Control Interface #3	0 - 500Hz pulse width modulation
Ethernet (2 port) 1 Gbps	COMMUNICATION	
	Ethernet (2 port)	1 Gbps



# PGC 4000v2 FUNCTION BLOCK DIAGRAM (TYPICAL SINGLE GENERATOR/UTILITY SYSTEM)

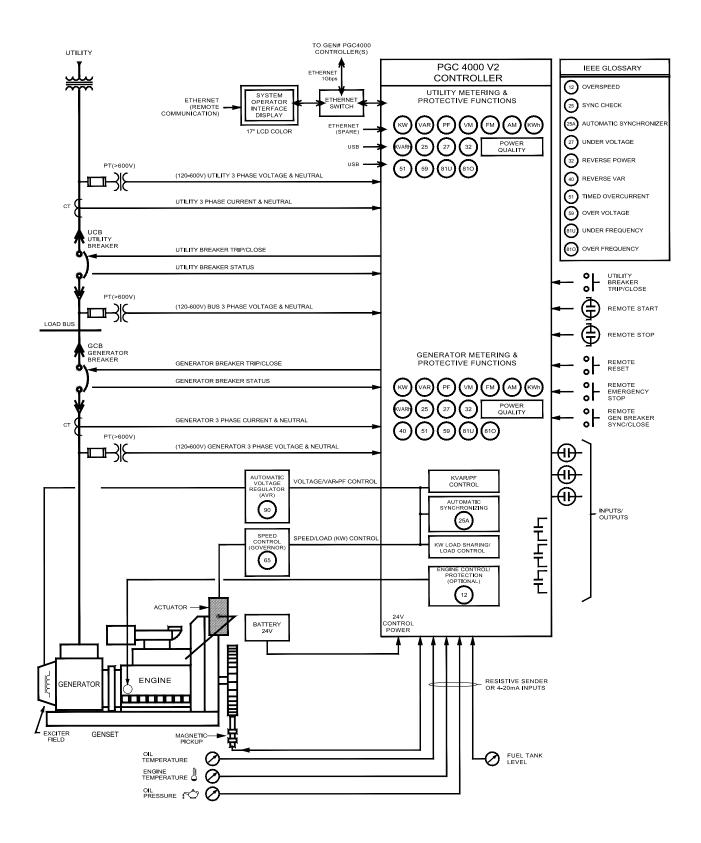

### SAFETY/PERFORMANCE STANDARDS

- UL 508, CSA C22.2 #14 Industrial Control Equipment Certification
- ANSI C12.20 Class 0.5 Metering Accuracy
- NFPA 110-99 Level 1 & 2 National Fire Protection Agency Emergency & Standby Power Systems
- NFPA 99 National Fire Protection Agency Health Care Facilities
- CSA C282 Emergency Electrical Power Supply for Buildings
- IEEE C62.41-1999 IEEE Recommended Practice on Surge Voltages in Low - Voltage AC Power Circuits
- IEEE C37.90.1-1989, IEEE Standard Surge Withstand Capability (SWC) Tests for Protective Relays and Relay Systems
- IEEE C37.90.2, IEEE Trial-Use Standard on Withstand Capability of Relay Systems to Radiated Electromagnetic Interference from Transceivers
- IEEE C37.90-1989, IEEE Standard for Relays and Relay Systems Associated with Electric Power Apparatus
- IEEE 1547 Standard for Interconnecting Distributed Resources with Electric Power Systems Compliance
- FCC, Radiated and Conducted Emissions (CFR47 Part 15/B)
- CISPR 22, CE for Conducted and Radiated Emissions Class A
- CE EN61000-6-3:2001 Emission Requirements (EN55022 Class A, B)
- CE EN61000-6-3:2001 Immunity Requirements (EN61000-4-(2-6)
- IEC 60255-22 Electrical Disturbance Tests for Measuring Relays and Protection Equipment (IEC 60255-22-(2-6)



Thomson Power Systems 4916 - 275th Street Langley, BC, Canada V4W 0A3 Customer Service: 604-888-0110 info@thomsonps.com www.thomsonps.com



NOTE: Specifications subject to change without notice.

#### APPLICATION CONSIDERATIONS

The proper selection and application of power generation products and components, including the related area of product safety, is the responsibility of the customer. Operating and performance requirements and potential associated issues will vary appreciably depending upon the use and application of such products and components. The scope of the technical and application information included in this publication is necessarily limited. Unusual operating environments and conditions, and other factors can materially affect the application and operating results of the products and components and the customer should carefully review it's requirements. Any technical advice or review furnished by Regal Beloit America, Inc. and its affiliates with respect to the use of products and components is given in good faith and without charge, and Regal assumes no obligation or liability for the advice given, or results obtained, all such advice and review being given and accepted at customer's risk.

For a copy of our Standard Terms and Conditions of Sale, Disclaimers of Warranty, Limitation of Liability and Remedy, please contact Customer Service at 1-888-888-0110. These terms and conditions of sale, disclaimers and limitations of liability apply to any person who may buy, acquire or use a Regal Beloit America Inc. product referred to herein, including any person who buys from a licensed distributor of these branded products.

REGAL

Thomson Power Systems and Regal are trademarks of Regal Beloit Corporation or one of its affiliated companies. ©2016, 2016 Regal Beloit Corporation, All Rights Reserved. CL059r4 19/09/30